문서번호	KUKJE-3732
Order No.	CWROM-1703-00379
P/No.	MFL67855539

최종 확인일자 : 2017-3-15

작업자	연구실 담당자
김재형 (055) 252-2915	김병국

개정일자:2016-6-1

QA 요청사항: 1. 원고에 지시된 대로 작업한 후 이상없이 작업 되었는지 재차 검토 후 PDF 파일을 생성한다.

2. 작업완료 후 담당 연구원에게 수정부분에 대한 검증요청한다.

(*** 반드시 필요 - 의뢰자가 요청한 의도대로 작업이 정확히 되었는지 반드시 확인이

필요함)

3. 아래 체크리스트에 따라 놓치기 쉬운 사항을 우선으로 한번 더 확인한다.

* 필수확인 - QA요구사항

작업원고와 수정내용이 일치하는가? (실패사례:영어/비영어 수정사항 동일한지 확인할것.)	× 예
언어표시띠의 위치(누락여부)는 바른가?	× 예
약물(기호)이 깨지거나 위치가 어긋 난 곳은 없는가?	× 01
그림이 가려지거나 잘려나간 곳은 없는가?	x 예
바코드와 P/No.가 일치하는가? (바코드 확인)	x 예
번역 작업중 번역이 적용되지 않고 누락된 단어나 문장은 없는가?	× 예

*최종 확인후 본 체크리스트는 삭제됩니다.





Please read this installation manual completely before installing the product. Installation work must be performed in accordance with the national wiring standards by authorized personnel only.

Please retain this installation manual for future reference after reading it thoroughly.

VENTILATOR

Original instruction



P/NO · MEI 67855539

TABLE OF CONTENTS

Installation requirements

Safety precautions.....3 Introduction7 Symbols used in this manual......7 Feature dimension diagram7 Installation11 Installation map.....11 Installation of main body....13 Connection of duct13 Method to connect power cord15 How to connect remote controller(accessory)......16 Group control.....17 Installer setting -How to enter installer setting mode18 Test running20 Method to operate and select air volume - Interlinked operation with ventilation......20 Method to operate and select air volume - Ventilation single operation21 In case of finding a problem at a test running......22 Airborne noise emission22

Available accessories22

Required parts

Required tools

- · Screws
- · Nuts
- · Ceiling fixing bolt(M10~12)
- Washer

- · Screw driver
- Spanner



Safety precautions

To prevent injury to the user or other people and property damage, the following instructions must be followed.

Incorrect operation due to ignoring instruction will cause harm or damage. The seriousness is classified by the following indications.

A WARNING

This symbol indicates the possibility of death or serious injury.

ACAUTION

This symbol indicates the possibility of injury or damage.

Meanings of symbols used in this manual are as shown below.

	Be sure not to do.	
•	Be sure to follow the instruction.	



Installation

Do not use a defective or underrated circuit breaker. Use this appliance on a dedicated circuit.

 There is risk of fire or electric shock.

For electrical work, contact the dealer. seller, a qualified electrician, or an authorized service center.

 Do not disassemble or repair the product. There is risk of fire or electric shock

Always ground the product.

· There is risk of fire or electric shock.

Install the panel and the cover of control box securely.

 There is risk of fire or electric shock.

Always install a dedicated circuit and breaker.

 Improper wiring or installation may cause fire or electric shock

Use the correctly rated breaker or fuse.

· There is risk of fire or electric shock.

Do not modify or extend the power cable.

 There is risk of fire or electric shock.

Do not install, remove, or re-install the unit by yourself (customer).

There is risk of fire, electric shock, explosion, or injury.

Be cautious when unpacking and installing the product.

Sharp edges could cause injury.

For installation, always contact the dealer or an authorized service center.

There is risk of fire, electric shock, explosion, or injury.

For re-installation of the installed product, always contact the dealer or an authorized service center.

There is risk of fire, electric shock, explosion or injury.

Install the air intake where polluted air can not be directly sucked in.

 It may cause various accidents, including suffocation, due to the suction of harmful gasses(CO, etc.) Do not install the product on a defective installation stand.

 It may cause injury, accident, or damage to the product.

Do not open the maintenance cover of the main body during operation.

 Otherwise, it may cause electrical shock.

Do not install this product in a refrigerated warehouse, heated swimming pool or other location where the temperature and humidity are significantly different.

 There is risk of electrical shock, malfunctioning. Do not let the product run for a long time when the humidity is very high and a door or a window is left open.

 Moisture may condense and wet or damage furniture.

Use the outdoor air suction hole with the net installed to ensure that birds could not come in.

 Remove estrange things like the bird's nest.
 Otherwise, it may cause scarcity of indoor oxygen.

Install this product in an environment where the temperature ranges from -10°C to +45°C and the relative humidity is less than 80%. It condensation is expected to form, heat up the fresh outside air using a duct heater etc.

Install this product in and environments where the outside air intake meets the following conditions: temperature range is between -15°C and +40°C and the relative humidity is 80% or less.

Use the designated electrical wires for the terminal board connections, and connect the wires securely so that they will not become disconnected. (Failure to ensure proper connections may cause fire.)

When passing metal ducts through wooden buildings clad with metal laths, wire laths or metal, these ducts must be installed in such a way that they will not make electrical contact with the metal laths, wire laths or metal sheets. (Power leakage can cause ignition)

Operation

When the product is soaked (flooded or submerged), contact an authorized service center.

 There is risk of fire or eletric shock

When flammable gas leaks, turn off the gas and open a window for ventilation before turn the product on.

 Do not use the telephone or turn switches on or off. There is risk of explosion or fire.

Don't touch a dedicated circuit or breaker with wet hands.

 There is risk of electric shock

Be cautious that water could not enter the product.

· There is risk of fire, electric shock, or product damage.

When the product is not be used for a long time, disconnect the power supply plug or turn off the breaker.

 There is risk of product damage or failure, or unintended operation.

Turn the breaker off when cleaning or maintaining the product.

 There is risk of electric shock

The outside ducts must be tilted at a gradient (1/30 or more) down toward the outdoor area from the ventilator unit, and properly insulated. (The entry of rain water may cause power leaks, fire or damage to household property.)

Glove should be worn when doing the installation work. (There is risk of injury.)

ACAUTION

Installation -

Don't connect the ground wire to the window frame or water cock.

 There is risk of electric shock. Do not install the product at a smoky and oily place like kitchen or factory.

 Otherwise. oil may adhere to the filter or heating exchanger and cause trouble. Install the product in an insulated space from outdoor air.

 In case of installing the product outside of the insulated layer, dewing occurs inside of the main body in winter. And it causes electrical shock or falling of condensed water.

Keep level even when installing the product.

To avoid vibration or water leakage.

Use two or more people to lift and transport the product.

· Avoid personal injury.

Do not install the product where it will be exposed to sea wind (salt spray) directly.

 It may cause corrosion on the product. Corrosion, particularly on the condenser and evaporator fins, could cause product malfunction or inefficient operation.

Operation

Use a soft cloth to clean. Do not use harsh detergents, wax or thinner, etc.

 Otherwise, color or surface of the oroduct may deteriorate. Clean the filter and the heat exchanger regularly and use the gloves for cleaning.

 Adhering to a mass of dust may cause the deterioration of air volume. Do not use the product for special purposes, such as preserving foods, works of art, etc. It is a consumer ventilator, not a precision refrigeration system.

 There is risk of damage or loss of property.

Do not block the inlet or outlet of air flow.

· It may cause product failure.

Do not step on or put anyting on the product.

There is risk of personal injury and failure of product.

Introduction

Symbols used in this manual



This symbol alerts you to the risk of electric shock.





This symbol alerts you to hazards that could cause harm to the product.

NOTICE This symbol indicates special notes.

Feature dimension diagram

Model: LZ-H025GBA4 / LZ-H035GBA4

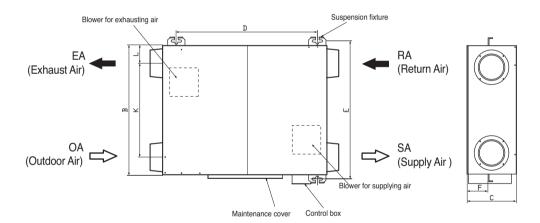




Unit: mm

Model	Figure			·			Pitch of suspension fixture			Nominal		onnection	flange	Duct	pitch	Weight
	Α	В	С	D	Е	F	ulametei	G	Н	J	K	L	kg			
LZ-H025GBA4 LZ-H035GBA4	1 014	988	273	939	1 025	135	200	194	252	96	590	198	44			

[#] It necessary to secure sufficient space for maintenance more than the dimensions described in the product service.

Model: LZ-H050GBA4

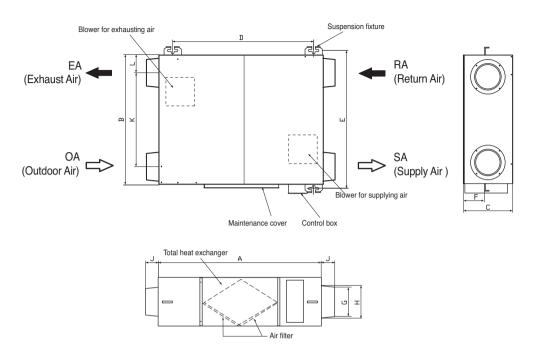


Unit: mm

Model		Figure		Pitch of suspension fixture					Duct connection flange			Duct pitch	
	Α	В	С	D	Е	F	diameter	G	Н	J	K	L	kg
LZ-H050GBA4	1 014	988	273	939	1 025	135	200	194	252	96	590	198	44

[★] It necessary to secure sufficient space for maintenance more than the dimensions described in the product service.

Model: LZ-H080GBA4 / LZ-H100GBA4

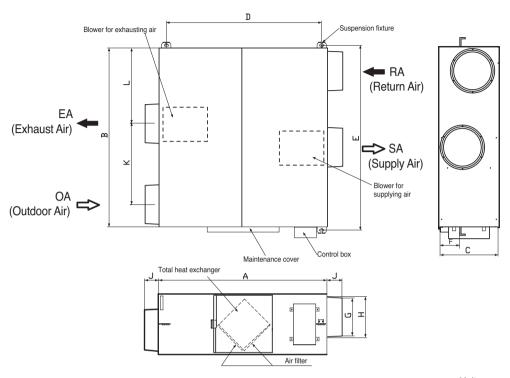



Unit: mm

Model		Figure		Pitch of	Pitch of suspension fixture			Duct co	onnection	flange	Duct	pitch	Weight
	Α	В	С	D	Е	F	diameter	G	Н	J	K	L	kg
LZ-H080GBA4 LZ-H100GBA4	1 062	1 140	365	987	1 176	180	250	242	253	98	513	481	62

 $\mbox{\%}$ It necessary to secure sufficient space for maintenance more than the dimensions described in the product service.

Model: LZ-H150GBA4 / LZ-H200GBA4



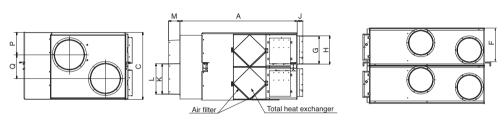

Unit: mm


Model	Figure		Pitch of suspension fixture			Duct connection flange					Duct pitch				Weight		
	Α	В	С	D	Е	F	G	Н	J	K	L	М	N	0	Р	Q	Kg
LZ-H150GBA4 LZ-H200GBA4	1 313	1 140	738	987	1 176	339	242	253	98	340	350	130	410	482	233	271	140

₩ It necessary to secure sufficient space for maintenance more than the dimensions described in the product service.


Installation

Installation map (LZ-H025GBA4/LZ-H035GBA4/LZ-H050GBA4/LZ-H080GBA4/LZ-H100GBA4)


Plane figure




Front view

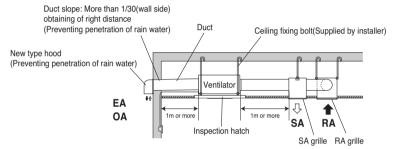

Three dimension view




Installation of maintenance cover




Installation map (LZ-H150GBA4/LZ-H200GBA4)


Plane figure

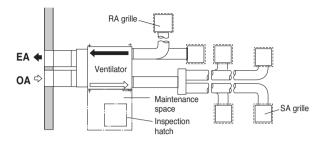


Front view

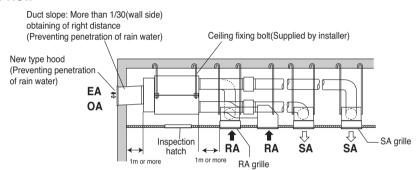

Three dimension view



Installation of maintenance cover




Installation of main body

Assembly of washer, nut

Tighten the common washer and nut (more than 21mm for the outside diameter of M10, to the commercial ceiling fixing bolt (M10) as shown in the right figure.

• For the ceiling fixing bolt, perform work less than 50mm under the ceiling fixing bracket.




Connection of duct

After securely connect the duct with the duct connection flange, wrap it with a commercial aluminium tape so that air cannot be leaked.

Adjust the duct from the ceiling so that no force is applied to the main body of the ventilation system.


Always use two ducts at the outdoor with the heat insulating material for prevention of dewing.






CAUTION:

- · Check that there are no foreign materials (paper, vinyl, etc) or cutoff powders in the duct before connecting the duct.
- · Take care so that shock may not be applied to the damper plate within the main body when performing the duct connection work.
- · It is recommended to perform adiabatic treatment even to the duct pipe at the indoor side where ambient temperature is expected higher than room temperature when the main body of the ventilation system for cooling in summer.
- · Take care so that work may not be performed as in the left figure. Otherwise, it may cause reduction of air volume or abnormal noise.





duct diameter



CAUTION:


· In -10°C below ambient temperature, when ventilation is installed the equivalent space in the outdoor and outdoor, It may cause condensation, you must install drainage facilities(drain pan) and MD(Motorized Damper) at SA/RA duct.

to outlet

Method to connect power cord


Release two screws and then open the cover of the control box.

With reference to the below wiring diagram, accurately connect the main power cords into the terminal block



After inserting the power cord into the bushing, fully insert it into the terminal block for connection.

- Fix the power cords with the clamp.
- Make sure that the power cords may not be removed by pulling them.

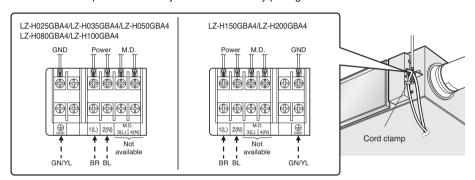

ACAUTION

The power cord connected to the unit should be selected according to the following specifications .

AWARNING

Indoor unit ground wires are required for preventing electrical shock accident during current leakage, Communication disorder by noise effect and motor current leakage (without connection to pipe).

Wiring specifications

Wiring specifications	Sheathed wire (should be complied with 60245 IEC 53 standard)
Size	0.75 - 1.25 mm ²
Length	MAX. 100 m
External contact specifications	Normally closed contact (Current tolerance 10 mA - 0.5 A)


Precautions when laying power wiring

Use round pressure terminals for connections to the power terminal block.



How to connect remote controller(accessory)

Please connect indoor unit and remote controller using connection cable.

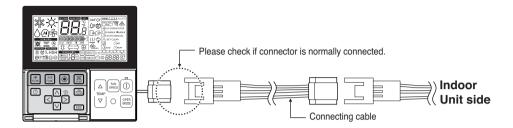

Please use extension cable if the distance between wired remote controller and indoor unit is more than 10m.

ACAUTION

When installing the wired remote controller, do not bury it in the wall.

(It can cause damage in the temperature sensor.)

Do not install the cable to be 50m or above.


(It can cause communication error.)

- · When installing the extension cable, check the connecting direction of the connector of the remote controller side and the product side for correct installation.
- If you install the extension cable in the opposite direction, the connector will not be connected.
- Specification of extension cable: 2547 1007 22# 2 core 3 shield 5 or above.

Group control


When installing more than 2 units of air conditioner to one wired remote controller, please connect as the right figure.

- · If it is not event communication indoor unit set the unit as slave
- · Check for event communication through the product manual.



When controlling multiple indoor units with event communication function with one remote controller, you must change the master/slave setting from the indoor unit.

- Indoor units, the master/slave configuration of the product after completion of indoor unit power 'Off' and then 'On' the power after 1 minutes elapsed sign up.
- For ceiling type cassette and duct product group, change the switch setting of the indoor PCB.



#1 switch Off: Master (Factory default setting)




#1 switch On: Slave

- For wall-mount type and stand type product, change the master/slave setting with the wireless remote controller. (Refer to wireless remote controller manual for detail)
- ★ When installing 2 remote controllers to one indoor unit with event communication function, set the master/slave of the remote controller. (Refer to remote controller master/slave selection)

When controlling the group, some functions excluding basic operation setting, fan level min/mid/max, remote controller lock setting and time setting may be limited.

When installing more than 2 wired remote controllers to one air conditioner, please connect as the right picture.

- When installing more than 2 units of wired remote controller to one air conditioner, set one wired remote controller as master and the others all as slaves, as shown in the right picture.
- · You cannot control the group as shown in the right for some products.
- · Refer to the product manual for more detail.



<When simultaneously connecting 2 sets of wired remote controller>


 When controlling in groups, set the master/slaver of the remote controller. Refer to Installer setting section on how to set master/slave for more detail.

Installer setting -How to enter installer setting mode


ACAUTION

Installer setting mode is to set the detail function of the remote controller.

If the installer setting mode is not set correctly, it can cause problems to the product, user injury or property damage. This must be set by an certificated installer, and any installation or change that is carried out by a non-certificated person should be responsible for the results. In this case, free service cannot be provided.



- If pressing button long for 3 seconds, it enters into remote controller setter setup mode.
 - If pressing once shortly, it enters into user setup mode. Please press more than 3 seconds for sure.
- When you enter the setting mode initially, Function code is displayed on the bottom of the LCD screen



· Some categories of the menu may not be displayed according to the function of the product, or the menu name may be different.

<Installer setting code table>

General ventilation product

No.	Function	Code	Value
1	Test run	01	01 : Test run setup
2	Address setting	02	00~FF : Address of central control
3	SA(Supply Air) ESP	03	<esp level=""> <esp value=""> <example> 01 : Low 0~255 II 3:II ! 15 s</example></esp></esp>
4	EA(Exhaust Air) ESP	04	02 : High 03 : Super high Function Code ESP step ESP value
5	Product direction	05	01 : Normal 02 : Opposite
6	Quick refresh priority	06	01 : Supply air first 02 : Exhaust air first
7	Master setting	07	00 : Slave 01 : Master
8	Dry contact	09	00 : Auto-off 01 : Auto-on
9	Release of 3 minute delay	10	01 : Set
10	Zone state test run	11	01 : Variable 02 : Fixed


[★] Some contents may not be displayed depending on the product function

Test running

Method to operate and select air volume – Interlinked operation with ventilation.


It is used when air conditioner is interlinked with ventilation product.

It is a function that cools and refreshes indoor air using the ventilation product at the same time operating the air conditioning function.

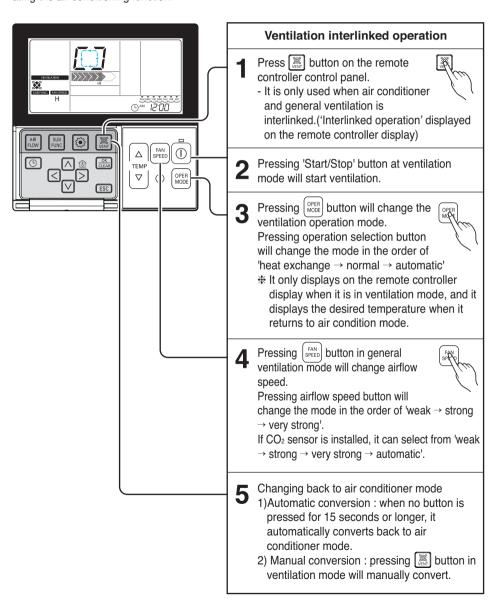

Method to operate and select air volume – Ventilation single operation

It is a function to cool and refresh the indoor air using general ventilation product...

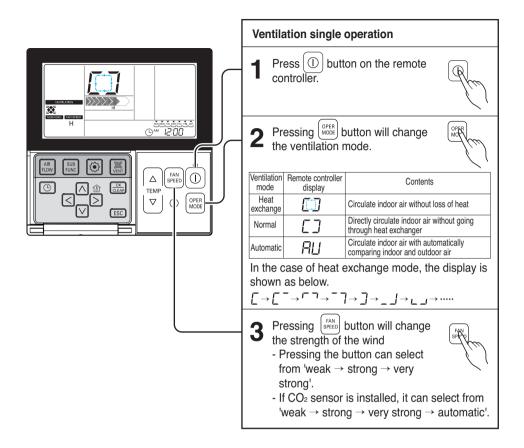

In case of finding a problem at a test running

Symptom	Check item	Counter-measure			
The product doesn't work	Is power not supplied?	Supply power			
	Is the indoor temperature less than 15 °C (59 °F) or more than 40 °C (104 °F)?	It's standby mode for protecting total heat exchanger.			
The product doesn't work through you press the 'On' switch	Is air filtecr, total heat exchanger clogged severely?	Follow cleaning and changing method.			
	Are the PCB and remote controller rightly connected?	Connect rightly PCB and remote controller.			
The fan doesn't run	"Is the outdoor temperature the limit temperature? (Less than -10°C (14°F), more than 45°C (113°F))"	Switch on Option No. 5. Repower the product and check whether it works or not. Switch off Option No. 5. and repower the product once again.			
Even though you push the button of remote controller, any function doesn't work.	Is the icon " " displaying on remote controller?	It's child lock mode. Refer to remote controller.			

Airborne noise emission

The A-weighted sound pressure emitted by this product is below 70 dB.

The figures quoted are emission level and are not necessarily safe working levels. Whilst there is a correlation between the emission and exposure levels, this cannot be used reliably to determine whether or not further precautions are required. Factor that influence the actual level of exposure of the workforce include the characteristics of the work room and the other sources of noise, i.e. the number of equipment and other adjacent processes and the length of time for which an operator exposed to the noise. Also, the permissible exposure level can vary from country to country. This information, however, will enable the user of the equipment to make a better evaluation of the hazard and risk.

Available accessories

Remote controller (PQRCVSL0/PQRCVSL0QW) F7 filter (AHFT035H0/AHFT050H0/AHFT100H0) CO₂ sensor (AHCS100H0) PI485 gateway

^{**} The noise level can vary depending on the site.

